


PULSE TRANSMITTER
SGF
SGFW
SGFL
INSTRUCTION MANUAL

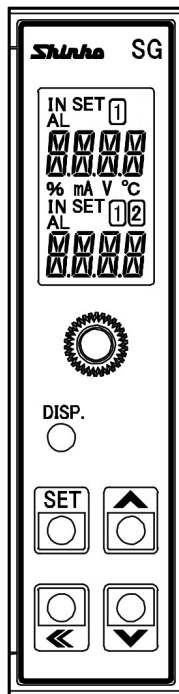

Shinko

Preface


Thank you for purchasing our SGF, SGFW or SGFL, Pulse Transmitter. This manual contains instructions for the mounting, functions, operations and notes when operating the SGF, SGFW or SGFL. To prevent accidents arising from the misuse of this instrument, please ensure the operator receives this manual.

Notes

- This instrument should be used in accordance with the specifications described in the manual. If it is not used according to the specifications, it may malfunction or cause a fire.
- Be sure to follow the warnings, cautions and notices. If they are not observed, serious injury or malfunction may occur.
- The contents of this instruction manual are subject to change without notice.
- Care has been taken to ensure that the contents of this instruction manual are correct, but if there are any doubts, mistakes or questions, please inform our sales department.
- This instrument is designed to be installed on a DIN rail within a control panel. If it is not, measures must be taken to ensure that the operator does not touch power terminals or other high voltage sections.
- Any unauthorized transfer or copying of this document, in part or in whole, is prohibited.
- Shinko Technos Co., Ltd. is not liable for any damage or secondary damage(s) incurred as a result of using this product, including any indirect damage.

SAFETY PRECAUTIONS (Be sure to read these precautions before using our products.)

The safety precautions are classified into categories: "Warning" and "Caution".

Depending on circumstances, procedures indicated by  Caution may result in serious consequences, so be sure to follow the directions for usage.



Warning

Procedures which may lead to dangerous conditions and cause death or serious injury, if not carried out properly.



Caution

Procedures which may lead to dangerous conditions and cause superficial to medium injury or physical damage or may degrade or damage the product, if not carried out properly.



Warning

- To prevent an electrical shock or fire, only Shinko or qualified service personnel may handle the inner assembly.
- To prevent an electrical shock, fire, or damage to instrument, parts replacement may only be undertaken by Shinko or qualified service personnel.



Safety Precautions

- To ensure safe and correct use, thoroughly read and understand this manual before using this instrument.
- This instrument is intended to be used for industrial machinery, machine tools and measuring equipment. Verify correct usage after purpose-of-use consultation with our agency or main office. (Never use this instrument for medical purposes with which human lives are involved.)
- External protection devices such as protective equipment against excessive temperature rise, etc. must be installed, as malfunction of this product could result in serious damage to the system or injury to personnel. Proper periodic maintenance is also required.
- This instrument must be used under the conditions and environment described in this manual. Shinko Technos Co., Ltd. does not accept liability for any injury, loss of life or damage occurring due to the instrument being used under conditions not otherwise stated in this manual.



Caution with Respect to Export Trade Control Ordinance

To avoid this instrument from being used as a component in, or as being utilized in the manufacture of weapons of mass destruction (i.e. military applications, military equipment, etc.), please investigate the end users and the final use of this instrument. In the case of resale, ensure that this instrument is not illegally exported.

■ Installation Precautions



Caution

This instrument is intended to be used under the following environmental conditions (IEC61010-1): Overvoltage category II, Pollution degree 2

Ensure the mounting location corresponds to the following conditions:

- A minimum of dust, and an absence of corrosive gases
- No flammable, explosive gases
- No mechanical vibrations or shocks
- No exposure to direct sunlight, an ambient temperature of -10 to 55°C (14 to 131°F) that does not change rapidly, and no icing
- An ambient non-condensing humidity of 35 to 85 %RH
- No large capacity electromagnetic switches or cables through which large current is flowing
- No water, oil or chemicals or the vapors of these substances can come into direct contact with the unit.
- When installing this unit within a control panel, please note that ambient temperature of this unit – not the ambient temperature of the control panel – must not exceed 55°C (131°F). Otherwise the life of electronic components (especially electrolytic capacitor) may be shortened.

Note: Avoid setting this instrument directly on or near flammable material even though the case of this instrument is made of flame-resistant resin.

■ Wiring Precautions



Caution

- Do not leave wire remnants in the instrument, as they could cause a fire and malfunction.
- When wiring, use a crimping pliers and a solderless terminal with an insulation sleeve in which an M3 screw fits.
- Tighten the terminal screw using the specified torque. If excessive force is applied to the screw when tightening, the screw or case may be damaged.
- This instrument does not have a built-in power switch, circuit breaker and fuse. It is necessary to install a power switch, circuit breaker and fuse near the instrument. (Recommended fuse: Time-lag fuse, rated voltage 250 V AC, rated current 2 A)
- For wiring of the AC power source, be sure to use terminals as described in this manual. If the AC power source is connected to incorrect terminals, the unit will be burnt out.
- Do not apply a commercial power source to the sensor which is connected to the input terminal nor allow the power source to come into contact with the sensor.
- Keep the input/output wires and power line separate.

■ Operation and Maintenance Precautions



Caution

- Do not touch live terminals. This may cause an electrical shock or problems in operation.
- Turn the power supply to the instrument OFF when retightening the terminal or cleaning.
Working on or touching the terminal with the power switched ON may result in severe injury or death due to electrical shock.
- Use a soft, dry cloth when cleaning the instrument.
(Alcohol based substances may tarnish or deface the unit.)
- As the display section is vulnerable, be careful not to put pressure on, scratch or strike it with a hard object.

Characters used in this manual [X : No character is indicated (unlit).]

Indication	4	0	1	2	3	4	5	6	7	8	9	C	F
Number, °C/°F	-1	0	1	2	3	4	5	6	7	8	9	°C	°F
Indication	A	b	C	d	E	F	G	H	I	J	K	L	M
Alphabet	A	B	C	D	E	F	G	H	I	J	K	L	M
Indication	N	ā	P	Q	R	S	T	U	V	W	X	Y	Z
Alphabet	N	O	P	Q	R	S	T	U	V	W	X	Y	Z


Contents

	Page
1. Model	5
1.1 Model	5
1.2 How to Read the Model Label	6
2. Name and Functions	7
2.1 Front Panel	7
2.2 Display Section	8
3. Mounting	9
3.1 External Dimensions (Scale: mm)	9
3.2 Mounting to, and Removal from the DIN Rail	10
4. Wiring	11
4.1 Lead Wire Solderless Terminal	11
4.2 Circuit Configuration	11
4.3 Terminal Arrangement	12
4.4 Wiring	13
5. Display Mode	15
6. Setting Mode	16
6.1 Display Transition in Setting Mode	16
6.2 Input Setting Mode	18
6.3 Output 1 Setting Mode	20
6.4 Output 2 Setting Mode	21
6.5 Instrument Setting Mode	22
6.6 Communication Setting Mode	23
6.7 Custom Display Setting Mode	25
6.8 Manual Mode	26
7. Operation	27
7.1 Indication after Power-on	27
7.2 Operation	27
7.3 Indication Time	27
7.4 Division Ratio	27
7.5 One-shot Output Pulse Width	28
7.6 Detecting Unconnected Sensor	29
7.7 Indication Range	29
8. Specifications	30
9. Troubleshooting	32
9.1 Indication	32
9.2 Key Operation	32
9.3 Operation	33
10. Character Table	34


1. Model

1.1 Model


SGF

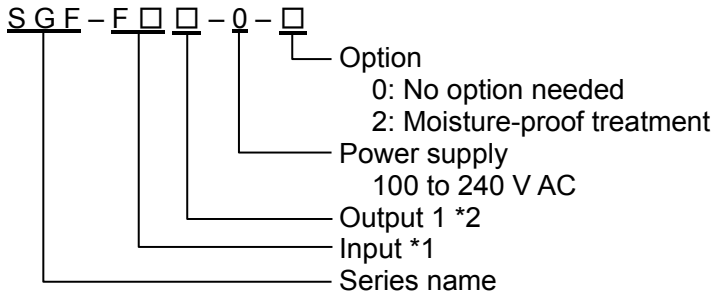

SGFW

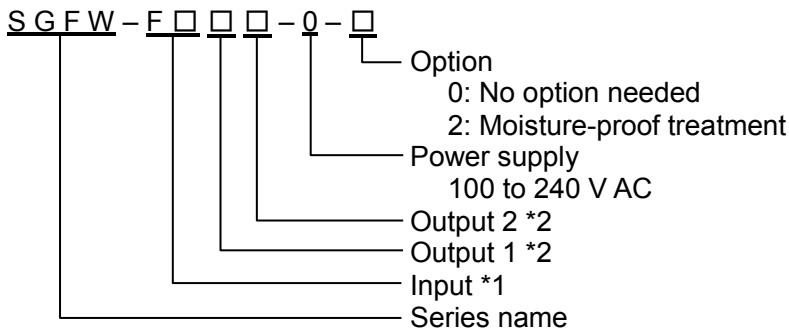

SGFL

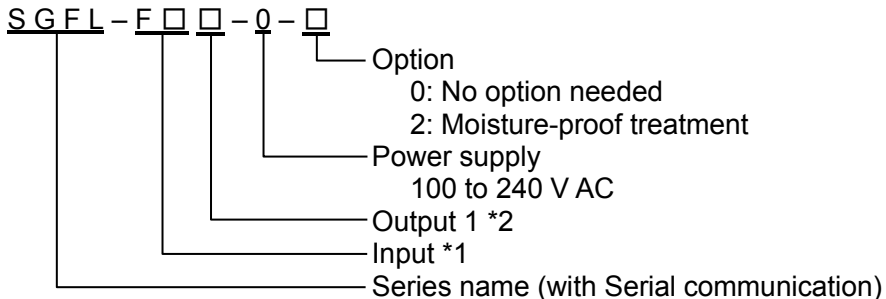

*1: Input


Code	Input Type	Input Range
F0	Open collector	0.001 Hz to 15 kHz
F1	Voltage pulse	0.001 Hz to 15 kHz
F2	Mechanical contact	0.001 Hz to 30 Hz
F3	Line driver	0.001 Hz to 15 kHz

*2: Output 1, Output 2

Code	Output Type	Output Range
O	Open collector	Output rating: 24 V DC / 100 mA Max. frequency: 15 kHz
P	Voltage pulse	Output rating: 12 V DC / 30 mA Allowable load resistance: 500 Ω minimum Max. frequency: 15 kHz

1.2 How to Read the Model Label

The model label is attached to the left side of the case.

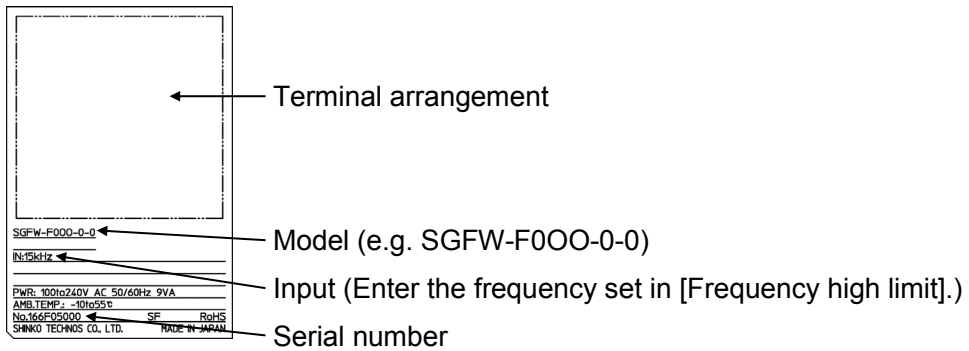


(Fig. 1.2-1)

2. Name and Functions

2.1 Front Panel

SGF, SGFL, SGFW

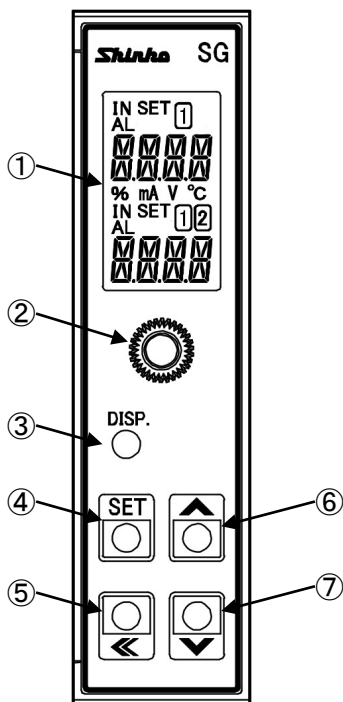


(Fig. 2.1-1)

①	Display section	Indicates setting contents, input value, output value, etc.
②	Mounting screw	Used for fixing the instrument to the socket or removal from it.
③	DISP key	Switches the displays, and moves to the next setting item. Releases the lock status of the DISP key by pressing for 3 seconds.
④	SET key	Selects either a setting mode or a display mode. Shifts the digit for the Custom Display. Enters the setting mode by pressing and holding for 5 seconds.
⑤	SHIFT key	Shifts the digit of setting value.
⑥	UP key	Increases the numerical value. Contents of Multi-Display A and B can be changed alternately when the Default Display is RUN display mode.
⑦	DOWN key	Decreases the numerical value. Enters Manual mode by pressing for 3 seconds.

2.2 Display Section

SGF, SGFL, SGFW

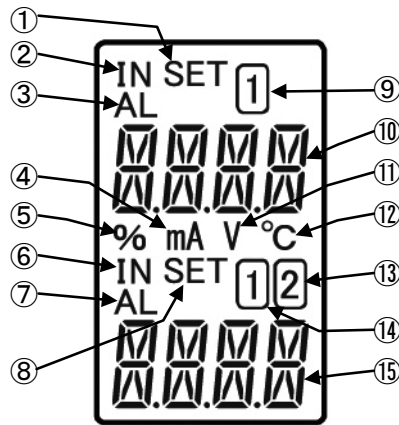

(Fig. 2.2-1)


①	Setting display indicator A	Lights up in Manual mode.
②	Input indicator A	Lights up while Multi-Display A indicates an input value.
③	Alarm indicator A	Lights up if an input error occurs in any display mode except All unlit display mode.
④	mA indicator A	Lights up when mA is selected in [Indication unit].
⑤	% indicator A	Lights up when % is selected in [Indication unit].
⑥	Input indicator B	Lights up while Multi-Display B indicates an input value.
⑦	Alarm indicator B	Lights up if an input error occurs when Multi-Display B indicates an input value.
⑧	Setting display indicator B	Lights up for the setting display.
⑨	1 indicator A	Lights up in Manual mode.
⑩	Multi-Display A	Indicates the following in accordance with the display indication: Input value, custom characters, setting item
⑪	V indicator A	Lights up when V is selected in [Indication unit].
⑫	°C indicator A	Lights up when °C is selected in [Indication unit].
⑬	2 indicator B	Lights up for Output 2 setting display.
⑭	1 indicator B	Lights up for Output 1 setting display.
⑮	Multi-Display B	Indicates the following in accordance with the display indication: Input value, custom characters, setting item

Alarm indicators A and B: Red

Other indicators: White


3. Mounting

3.1 External Dimensions (Scale: mm)

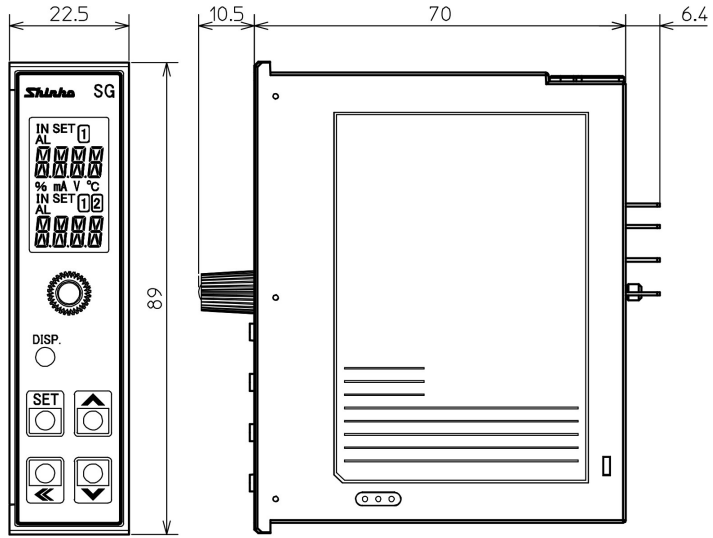

8P socket (SGF, SGFL)

11P socket (SGFW)

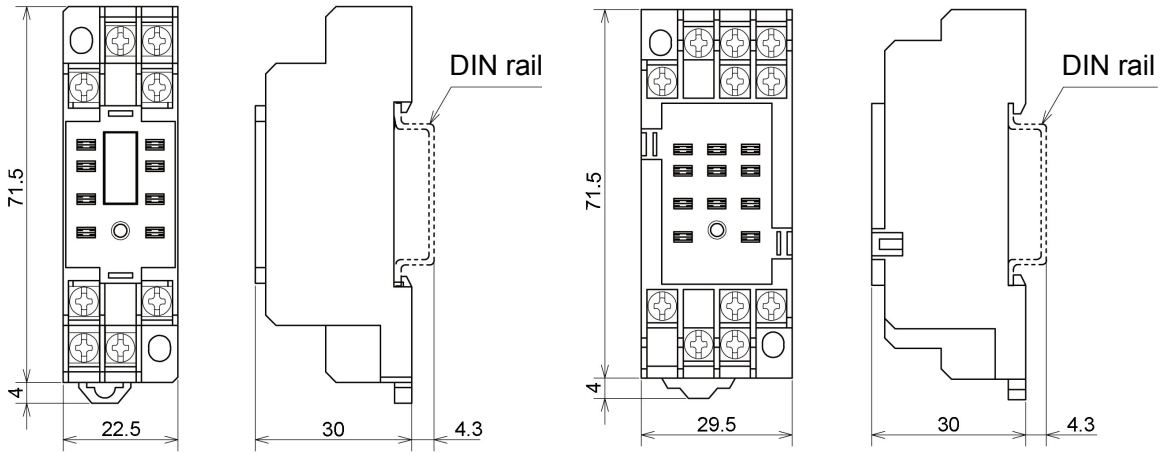

(Fig. 3.1-1)

3.2 Mounting to, and Removal from the DIN Rail



Caution

- Mount the DIN rail horizontally.
- To remove the socket, a flat blade screwdriver is required.
Never turn the screwdriver when inserting it into the Lock lever. If excessive power is applied to the lever, it may break.
- If the instrument is mounted in a position susceptible to vibration or shock, mount commercially available fastening plates at both ends of the instrument.

Recommended Fastening Plate

Manufacturer	Model
Omron Corporation	End plate PFP-M
IDEC Corporation	Fastening plate BNL6
Panasonic Electric Works Co., Ltd.	Fastening plate ATA4806

Mounting to the DIN rail (Fig. 3.2-1)

- ① Separate the instrument from the socket by loosening the mounting screw on the front panel.
- ② Make sure the lock lever of the socket is located in the lower part of the socket.
Hook the upper side of the socket onto the DIN rail, then fit the lower part of the socket onto the DIN rail (A clicking sound should be heard when done properly).




Caution

- Before inserting the instrument to the socket, make sure the cable is wired properly. (Refer to “4. Wiring”.)
- When inserting or removing the socket, make sure the socket is oriented vertically. If force is applied in any other direction than vertically, a malfunction may occur.
- If the mounting screw is fastened too tightly, a malfunction may occur.


- ③ Insert the SGF into the socket.
- ④ Fasten the mounting screw by turning it clockwise, to secure the SGF onto the socket.
Tighten the screw lightly.

Removal from the DIN rail (Fig. 3.2-2)

- ① Turn the power to the instrument OFF.
- ② Separate the instrument from the socket by loosening the mounting screw on the front panel.
- ③ Insert a flat blade screwdriver into the Lock lever (lower part of the socket), and remove the socket from the DIN rail while pulling the lever down.

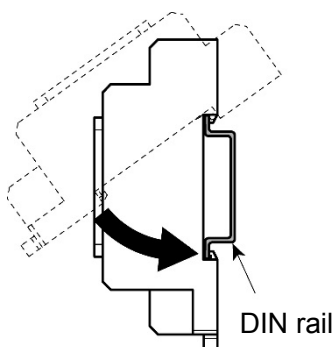

(Fig. 3.2-1)

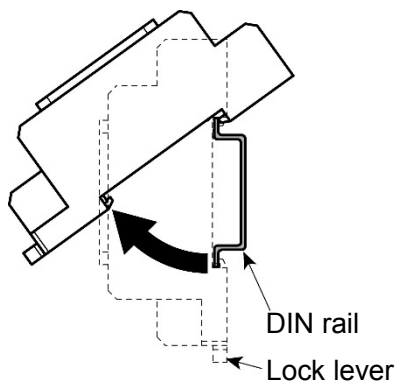

(Fig. 3.2-2)

4. Wiring



Warning


Turn the power supply to the instrument off before wiring or checking. Working on or touching the terminal with the power switched on may result in severe injury or death due to electrical shock.

4.1 Lead Wire Solderless Terminal

Use a solderless terminal with an insulation sleeve in which an M3 screw fits as shown below. The torque should be 0.63 N•m.


Solderless Terminal	Manufacturer	Model
Y-type	Nichifu Terminal Industries Co., Ltd.	TMEV1.25Y-3
	Japan Solderless Terminal MFG Co., Ltd.	VD1.25-B3A
Ring-type	Nichifu Terminal Industries Co., Ltd.	TMEV1.25-3
	Japan Solderless Terminal MFG Co., Ltd.	V1.25-3

Y-type(Scale: mm)

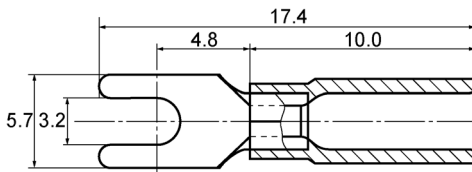

(Fig. 4.1-1)


Ring-type(Scale: mm)

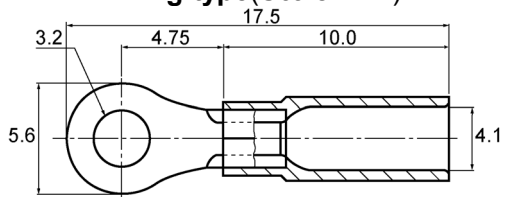

(Fig. 4.1-2)


4.2 Circuit Configuration

SGF, SGFL

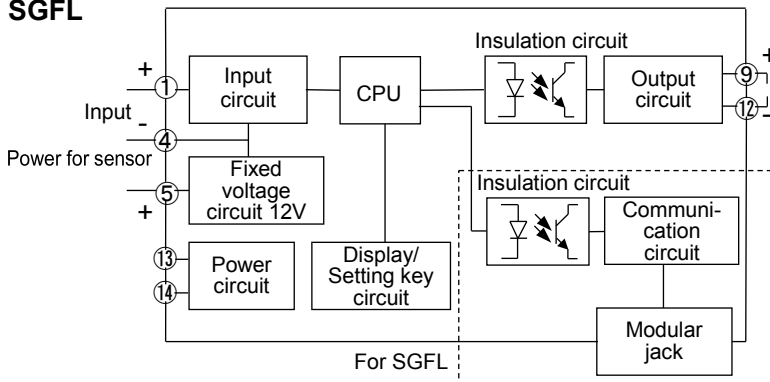

(Fig. 4.2-1)


SGFW

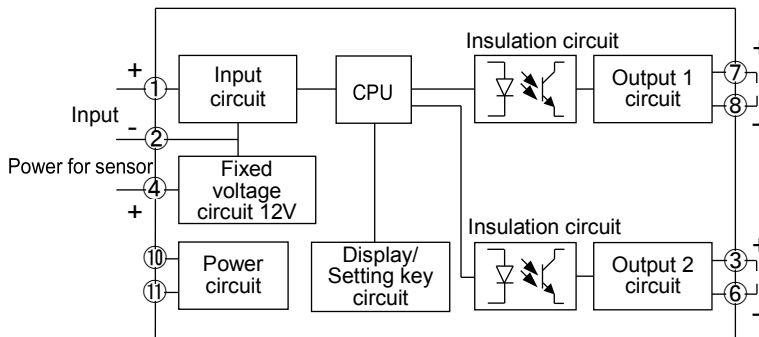

(Fig. 4.2-2)


4.3 Terminal Arrangement

SGF

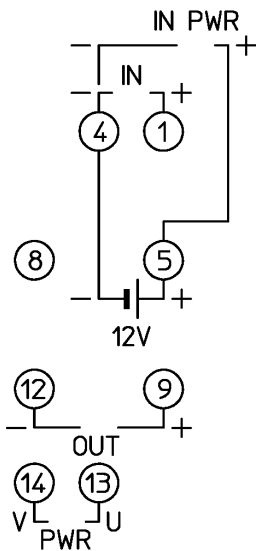


(Fig. 4.3-1)

SGFL

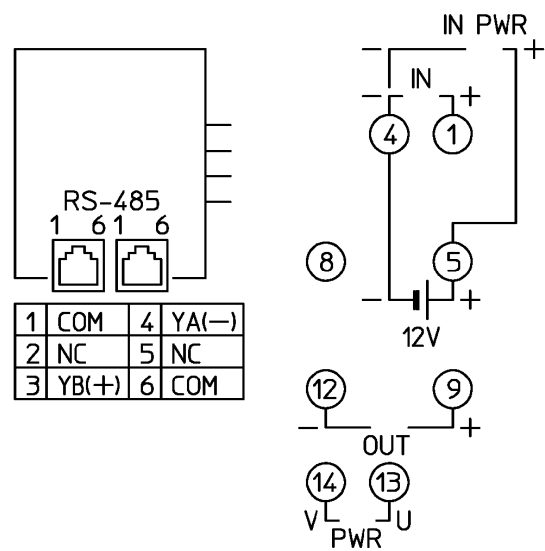

(Fig. 4.3-2)

SGFW

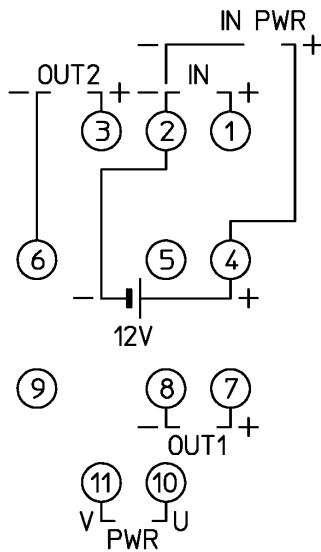

(Fig. 4.3-3)

PWR	Power supply 100 to 240 V AC
OUT(OUT1)	Output or Output 1 (for SGFW)
OUT2	Output 2 (for SGFW)
IN	Input
IN PWR	Power for sensor 12 V DC
RS-485	Serial communication (for SGFL)

4.4 Wiring



Warning

- For 100 to 240 V AC, if the AC power source is connected to incorrect terminals, the instrument will be burnt out.

(1) Power Source Wiring

SGF, SGFL: Use terminals ⑬, ⑭ for the power supply to the instrument.

SGFW: Use terminals ⑩, ⑪ for the power supply to the instrument.

(2) Output Wiring

SGF, SGFL: Use terminals ⑨(+), ⑫(-) for the output wiring.

SGFW: Output 1: Use terminals ⑦(+), ⑧(-) for Output 1 wiring.


Output 2: Use terminals ③(+), ⑥(-) for Output 2 wiring.

(3) Input Wiring

SGF, SGFL: Use terminals ①, ④, ⑤ for the input wiring.


SGFW: Use terminals ①, ②, ④ for the input wiring.

Open collector
SGF, SGFL

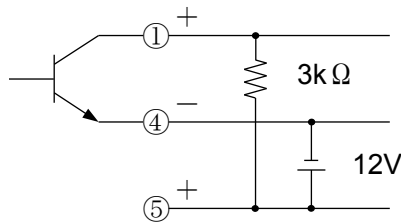


(Fig. 4.4-1)

SGFW

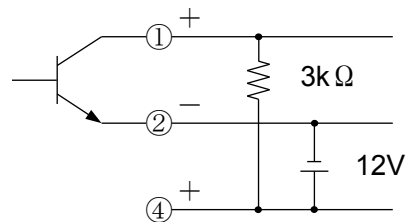


(Fig. 4.4-2)

Voltage pulse
SGF, SGFL

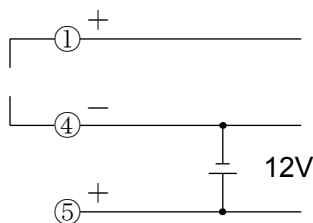


(Fig. 4.4-3)

SGFW

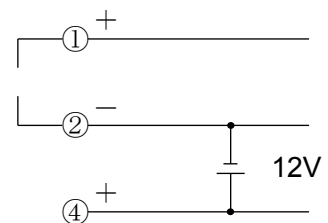


(Fig. 4.4-4)

Mechanical contact
SGF, SGFL

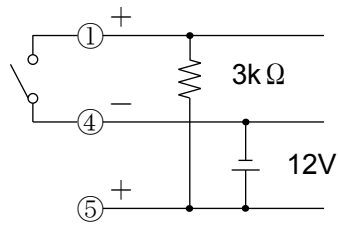


(Fig. 4.4-5)

SGFW

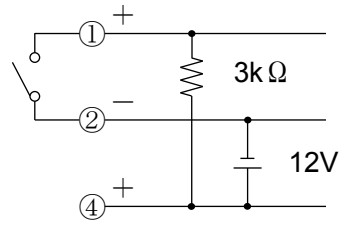


(Fig. 4.4-6)

Line driver
SGF, SGFL

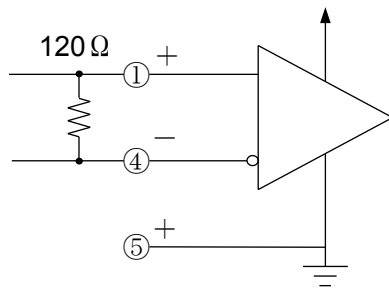

(Fig. 4.4-7)


SGFW

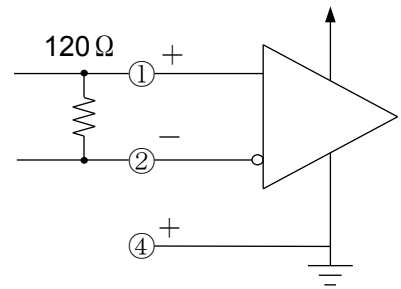

(Fig. 4.4-8)


(4) Communication Wiring

For SGFL, connect the SGFL to SGFL using the provided cable.

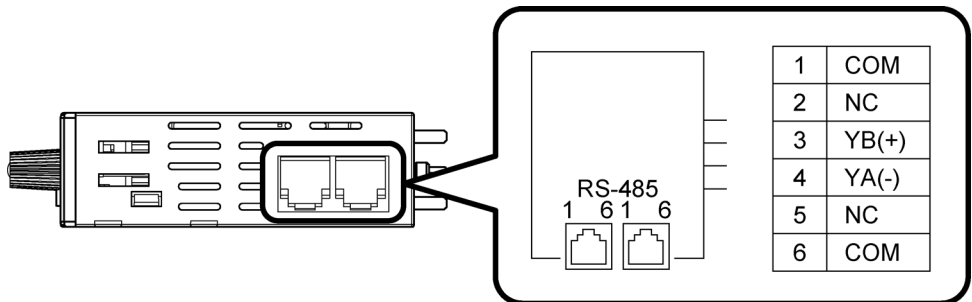

(Fig. 4.4-9)

5. Display Mode

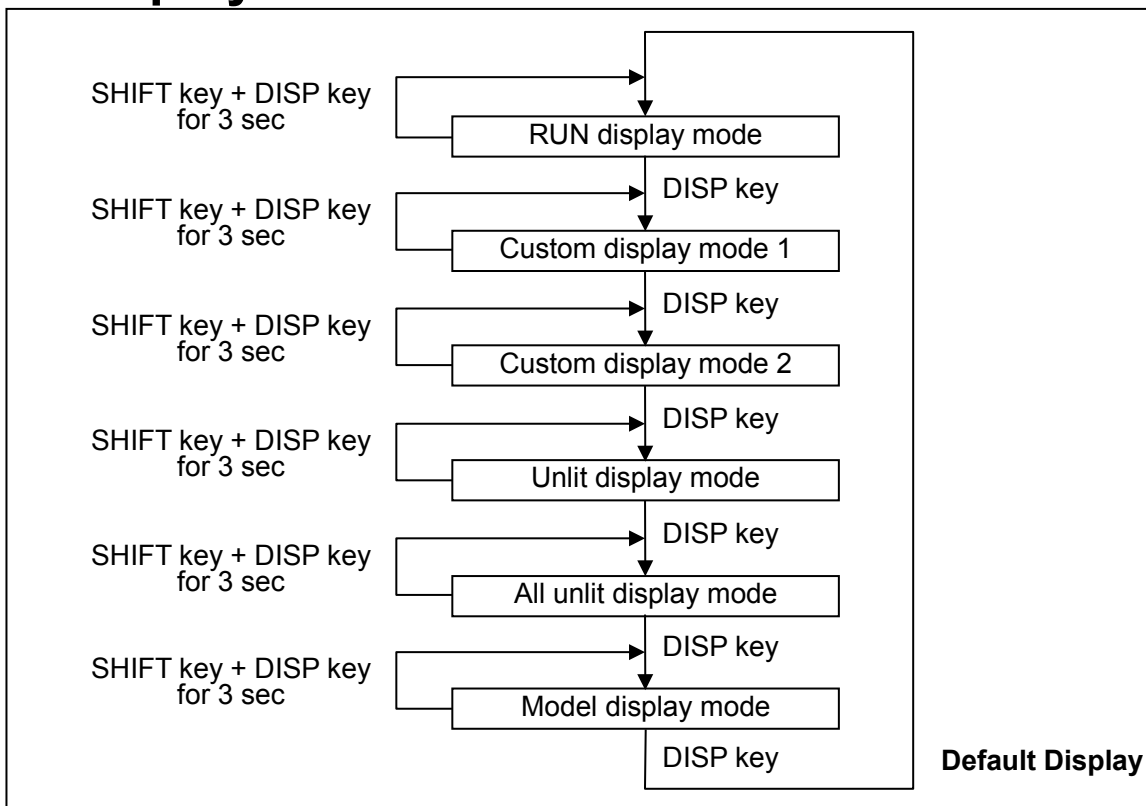

Default Display:

If the SHIFT and DISP keys (in that order) are pressed together for approx. 3 seconds in any display mode, the display mode will become the Default Display. Once the Default Display is set, the DISP key will be in lock status. If the DISP key is pressed for approx. 3 seconds on the Default Display, the key lock status will be cancelled. If the DISP key is pressed while the DISP key is in lock status, Multi-Display A indicates **LOCK**.

RUN display mode:

Multi-Display A indicates an input value, and Multi-Display B is unlit.

Custom display mode 1:

Multi-Display A indicates characters set in [Multi-Display A]. Multi-Display B indicates characters set in [Multi-Display B].

Custom display mode 2:

Multi-Display A indicates an input value, and Multi-Display B indicates characters set in [Multi-Display B].

Unlit display mode:

Multi-Display A and B are unlit, and the Input indicator A lights up. Alarm indicator A lights up if it is under the conditions of lighting.

All unlit display mode:



All displays and indicators are unlit. Alarm indicator A does not light up even if it is under the conditions of lighting.


Model display mode:


Multi-Display A indicates a model name, and Multi-Display B indicates an input code and output code.

6. Setting Mode

6.1 Display Transition in Setting Mode

-  : Available only for the SGFW.
-  : Available only for the SGFL.
- If the SET key is pressed and held down for approx. 5 seconds in each setting mode, the unit will move to the Default Display.

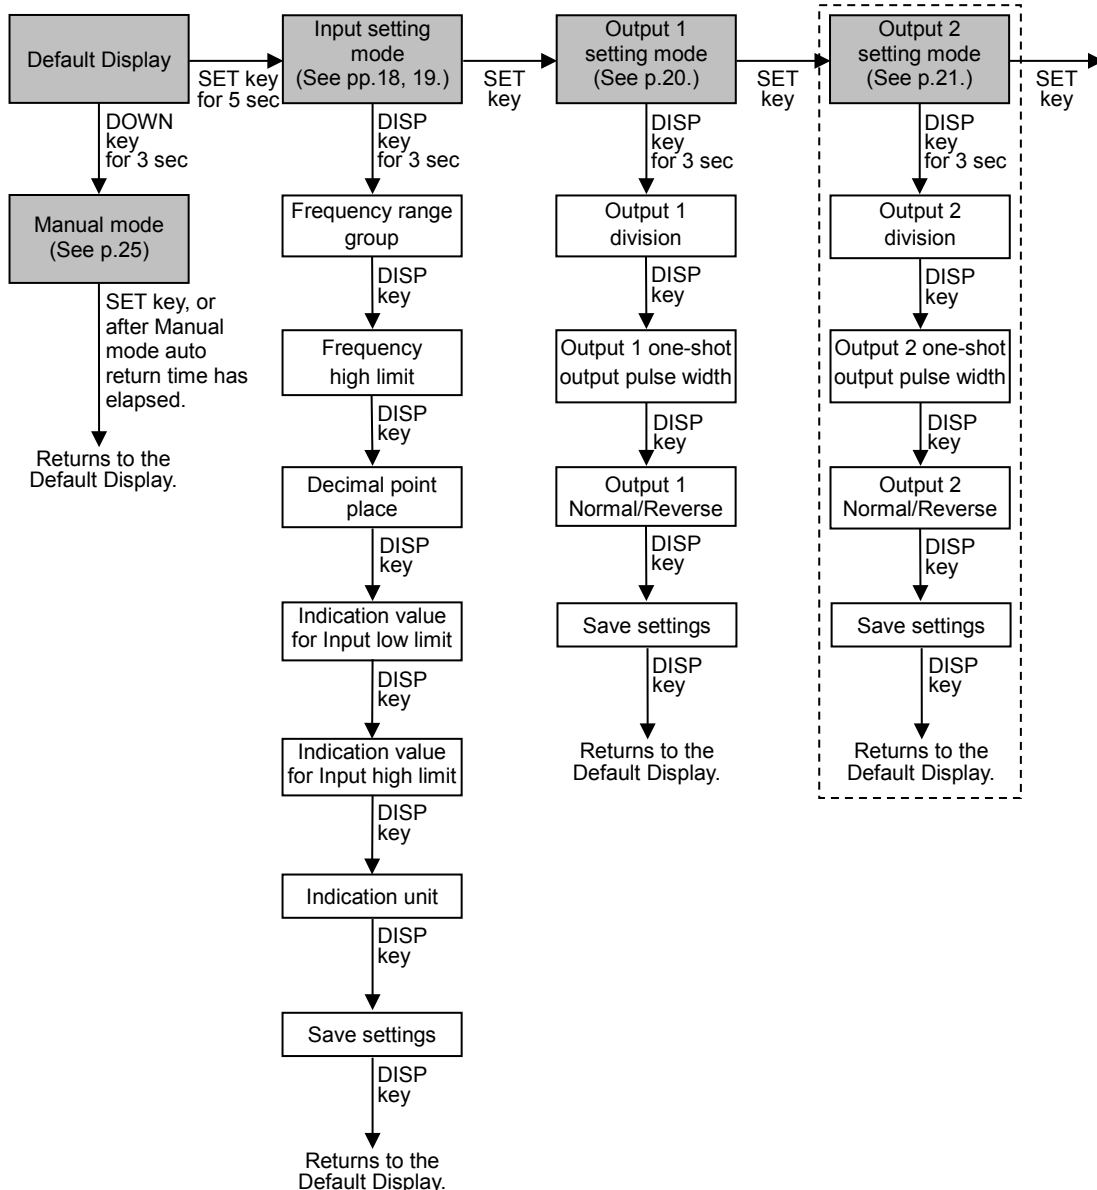

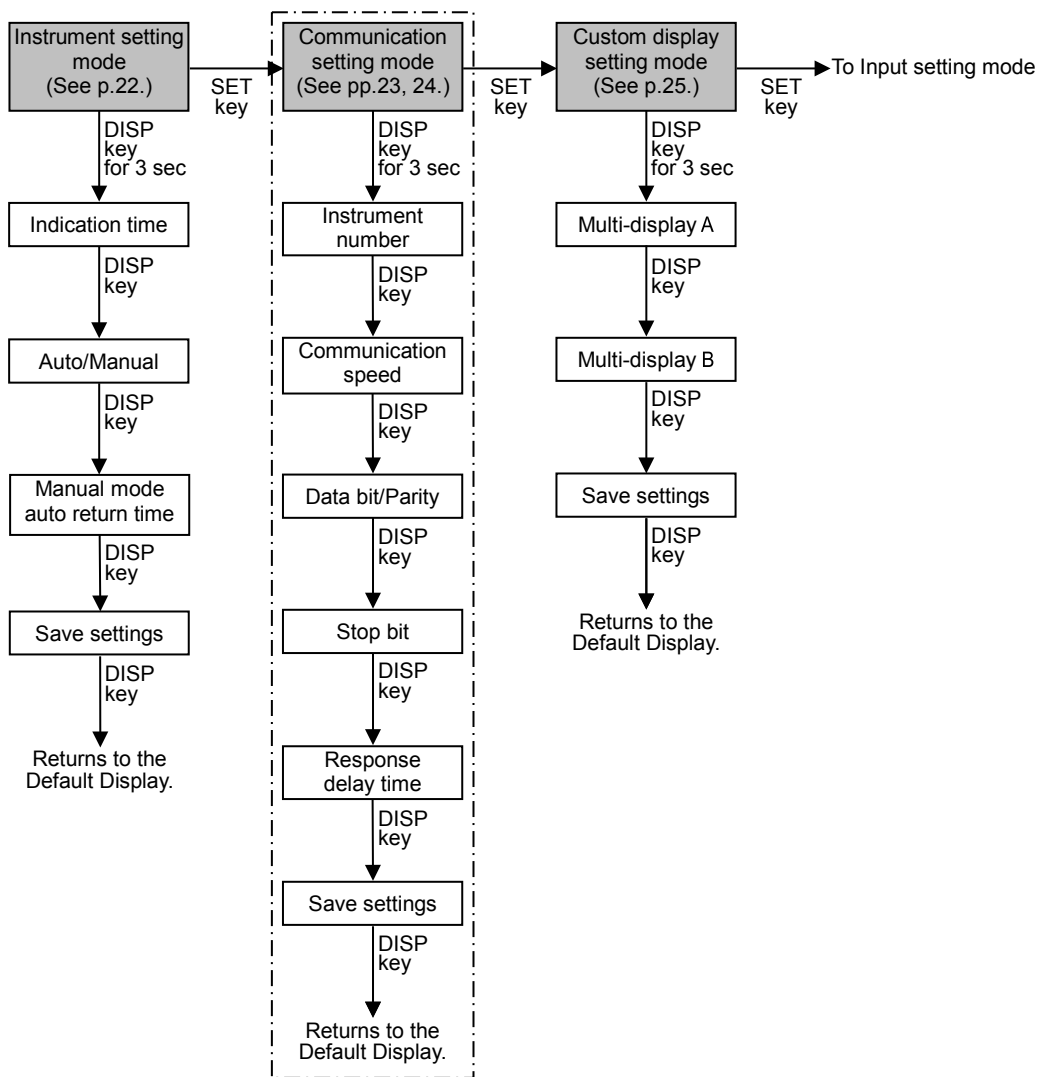

6.2 Input Setting Mode

Frequency Range Group

Selects the frequency range group.

Setting Range	Indication		Factory Default
	Multi-Display A	Multi-Display B	
Ultra-low frequency	HZSE	MHZ	Low frequency HZSE
Low frequency		HZ	
Frequency		KHZ	

Frequency High Limit

Sets the frequency high limit.

Setting Range	Indication		Factory Default
	Multi-Display A	Multi-Display B	
Ultra-low frequency: 10 to 9999 mHz	HZSE	Set value	9999 Hz HZSE SESE
Low frequency: 1 to 9999 Hz			
Frequency: 1 to 15 kHz			

Decimal Point Place

Selects the decimal point place.

Setting Range	Indication		Factory Default
	Multi-Display A	Multi-Display B	
No decimal point	SESE	SESE	No decimal point SESE SESE
1 digit after decimal point		SESE	
2 digits after decimal point		SESE	
3 digits after decimal point		SESE	

Indication Value for Input Low Limit

Sets the indication value for the Input low limit.

Setting Range	Indication		Factory Default
	Multi-Display A	Multi-Display B	
-1999 to Indication value for Input high limit	SESE	Set value	0 SESE SESE

Indication Value for Input High Limit

Sets the indication value for the Input high limit.

Setting Range	Indication		Factory Default
	Multi-Display A	Multi-Display B	
Indication value for Input low limit to 9999	SESE	Set value	Frequency high limit SESE SESE

Indication Unit

Selects the indication unit.

Setting Range	Indication		Factory Default
	Multi-Display A	Multi-Display B	
No unit	NONE	NONE	No unit NONE NONE
%		PER	
mA		MA	
V		V	
°C		C	

Save Settings

Selects whether the settings are saved (registered) or not.

Setting Range	Indication		Factory Default
	Multi-Display A	Multi-Display B	
Save	SAVE	YES	Save SAVE YES
Not save		NO	

6.3 Output 1 Setting Mode

Output 1 Division

Sets Output 1 division value to obtain the division ratio of the input pulse.

Setting Range	Indication		Factory Default
	Multi-Display A	Multi-Display B	
1 to 9999	0000	Set value	1 0000 0000

Output 1 One-shot Output Pulse Width

Sets one-shot output pulse width for Output 1.

Setting Range	Indication		Factory Default
	Multi-Display A	Multi-Display B	
0 to 400 msec *	0000	Set value	0 0000 0000

* When set to 0 (zero), the one-shot output function is disabled.

Output 1 Normal/Reverse

Selects either Normal mode or Reverse mode for Output 1 status.

Setting Range	Indication		Factory Default
	Multi-Display A	Multi-Display B	
Normal	0000	N0M0	Normal 0000 N0M0
Reverse		REVS	

Save Settings

Selects whether the settings are saved (registered) or not.

Setting Range	Indication		Factory Default
	Multi-Display A	Multi-Display B	
Save	0000	0000	Save 0000 0000
Not save		N000	

6.4 Output 2 Setting Mode

Available only for the SGFW.

Output 2 Division

Sets Output 2 division value to obtain the division ratio of the input pulse.

Setting Range	Indication		Factory Default
	Multi-Display A	Multi-Display B	
1 to 9999		Set value	1

Output 2 One-shot Output Pulse Width

Sets one-shot output pulse width for Output 2.

Setting Range	Indication		Factory Default
	Multi-Display A	Multi-Display B	
0 to 400 msec *		Set value	0

* When set to 0 (zero), the one-shot output function is disabled.

Output 2 Normal/Reverse

Selects either Normal mode or Reverse mode for Output 2 status.

Setting Range	Indication		Factory Default
	Multi-Display A	Multi-Display B	
Normal			Normal
Reverse			

Save Settings

Selects whether the settings are saved (registered) or not.

Setting Range	Indication		Factory Default
	Multi-Display A	Multi-Display B	
Save			Save
Not save			

6.5 Instrument Setting Mode

Indication Time

Sets duration from no operation until indication (of Multi-Display A, Multi-Display B, and each action indicator) turns off.

They remain lit during setting mode or in the event of an input error.

When set to 00.00, they remain lit.

After indication time has elapsed, if any key is pressed while they are unlit, they will light up again.

Setting Range	Indication		Factory Default
	Multi-Display A	Multi-Display B	
00 : 00 to 60 : 00 (Minutes : Seconds) 00 : 00Continuous 00 : 01 to 60 : 00.Indication time		Set value	30 : 00 (Minutes : Seconds)

Auto/Manual

If AUTO is selected, the output value will be output corresponding to the input value.

When MANUAL is selected, the unit can enter Manual mode. The output frequency selected in Manual mode will be output.

Setting Range	Indication		Factory Default
	Multi-Display A	Multi-Display B	
Auto			Manual
Manual			

Manual Mode Auto Return Time

Sets duration from manual mode until the unit automatically returns to the Default Display.

If set to 0 (zero), auto return will not occur.

Setting Range	Indication		Factory Default
	Multi-Display A	Multi-Display B	
0 to 60 minutes		Set value	30 minutes

Save Settings

Selects whether the settings are saved (registered) or not.

Setting Range	Indication		Factory Default
	Multi-Display A	Multi-Display B	
Save			Save
Not save			

6.6 Communication Setting Mode

Available only for the SGFL.

Instrument Number

Sets an instrument number.

Setting Range	Indication		Factory Default
	Multi-Display A	Multi-Display B	
1 to 247		Set value	1

Communication Speed

Selects the communication speed.

Setting Range	Indication		Factory Default
	Multi-Display A	Multi-Display B	
9600 bps			38400 bps
19200 bps			
38400 bps			

Data bit/Parity

Selects data bit and parity.

Setting Range	Indication		Factory Default
	Multi-Display A	Multi-Display B	
8 bits/No parity			8 bits/Odd
8 bits/Even			
8 bits/Odd			

Stop Bit

Selects the stop bit.

Setting Range	Indication		Factory Default
	Multi-Display A	Multi-Display B	
1 bit			1 bit
2 bits			

Response Delay Time

Response from the instrument can be delayed after receiving command from the host computer.

Setting Range	Indication		Factory Default
	Multi-Display A	Multi-Display B	
0 to 1000 ms		Set value	10 ms

Save Settings

Selects whether the settings are saved (registered) or not.

Setting Range	Indication		Factory Default
	Multi-Display A	Multi-Display B	
Save	SAVE	SSS	Save SAVE SSS
Not save		NOSS	

6.7 Custom Display Setting Mode

Customizes characters to be indicated on the Multi-Display A and B (*).
Use alphanumeric characters and symbols.

(e.g.) FLOW, TEMP, No.1, No.2

(*) Number of characters which can be indicated differs depending on the display mode.

Refer to Section '5. Display Mode' (p.13).



- If Custom display mode 1 is selected:
Up to 8 characters can be displayed in total for both Multi-Display A and B.
- If Custom display mode 2 is selected:
Up to 4 characters can be displayed on the Multi-Display B.

Can be set from the thousands digit of the display.

Digits can be selected with the SET key.



Multi-Display A

Characters for the Multi-Display A can be customized.

Setting Range	Indication		Factory Default
	Multi-Display A	Multi-Display B	
A to Z, 0 to 9, /, -, ., (Blank)		Set value	AAAA 





Multi-Display B

Characters for the Multi-Display B can be customized.

Setting Range	Indication		Factory Default
	Multi-Display A	Multi-Display B	
A to Z, 0 to 9, /, -, ., (Blank)		Set value	AAAA 

Save Settings

Selects whether the settings are saved (registered) or not.

Setting Range	Indication		Factory Default
	Multi-Display A	Multi-Display B	
Save			Save 
Not save			

6.8 Manual Mode

If MANUAL is selected in [Auto/Manual] in Instrument setting mode, and if the DOWN key is pressed for 3 seconds, then the unit can enter Manual mode.

The output frequency can be selected by the UP or DOWN key.

By pressing the SET key in Manual mode, or after Manual mode auto return time has elapsed, the unit returns to the Default Display.

Frequency

Setting Range	Indication		Factory Default
	Multi-Display A	Multi-Display B	
0.1 Hz	0.00H	Unlit	0.1 Hz 0.00H
1 Hz	0.00H		
2 Hz	0.02H		
4 Hz	0.04H		
8 Hz	0.08H		
10 Hz	0.10H		
20 Hz	0.20H		
40 Hz	0.40H		
80 Hz	0.80H		
100 Hz	1.00H		
200 Hz	2.00H		
400 Hz	4.00H		
800 Hz	8.00H		
1 kHz	1.00K		
2 kHz	2.00K		
4 kHz	4.00K		
8 kHz	8.00K		
10 kHz	10.00K		

7. Operation

7.1 Indication after Power-on


After the power is turned on, the instrument is switched to warm-up status for 3 seconds. Multi-Display A indicates a model name, and Multi-Display B indicates the input code, Output 1 code and Output 2 code as follows.


The thousands and hundreds digits: Input code

The tens digit: Output 1 code

The ones digit: Output 2 code

(e.g.) SGFW-F000-0-0

Multi-Display A: 

Multi-Display B: 

7.2 Operation

After warm-up, the unit proceeds to display mode.

The input type selected in [Frequency range group] will be converted to the pulses set in Output 1 setting mode and Output 2 setting mode.

7.3 Indication Time

After preset indication time has elapsed, Multi-Display A, Multi-Display B and each action indicator are turned OFF.

They light up again if any key is pressed.

They remain lit during setting mode or in the event of an input error.

If the indication time is set to 00:00, they remain lit.


7.4 Division Ratio

By setting Output 1 and Output 2 division values, obtains the division ratio (of the input value) for Output 1 and Output 2 (for SGFW only).


Division ratio is obtained by the following formula.

$$\text{Division ratio} = \frac{1}{\text{Output 1 (or Output 2) division}}$$

One-shot output pulse width: 0, Division ratio: 1/2

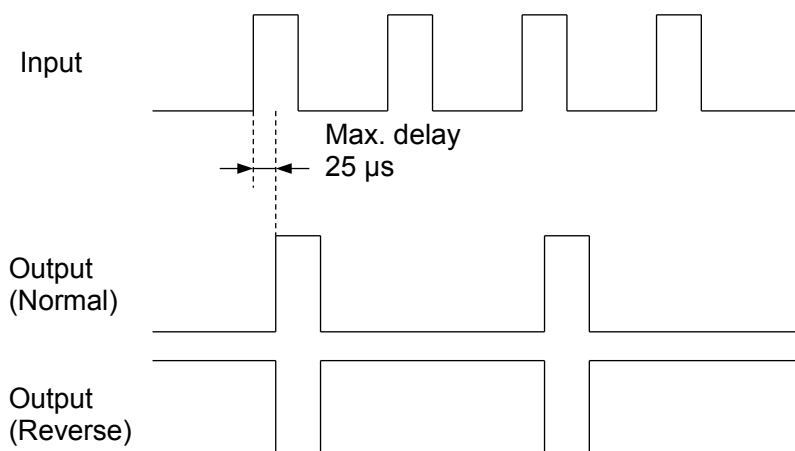

One-shot output pulse width: Any value except 0, Division ratio: 1/2

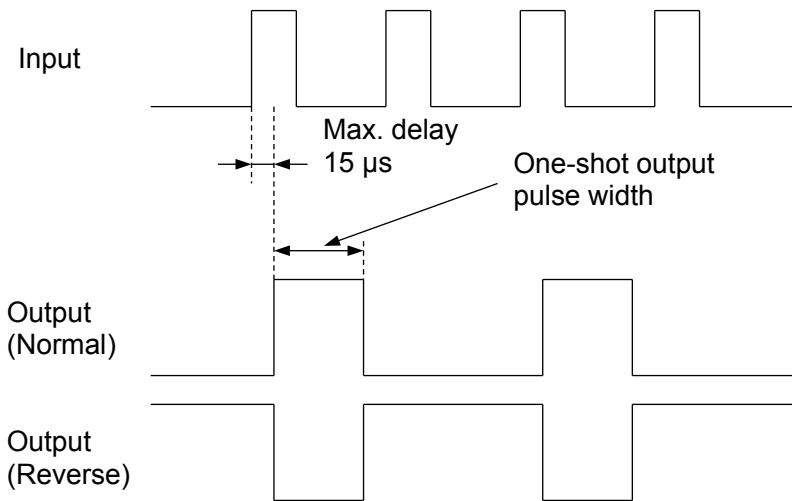


7.5 One-shot Output Pulse Width

If input pulses are entered, the output pulses will be output with the time set in [Output 1 one-shot output pulse width] or [Output 2 one-shot output pulse width].


However, if one-shot output pulse width is set to 0 (zero), this function will be disabled, and the pulse width of input and output will be the same.

Pulse width accuracy: If input pulse width is 1 ms, and if one-shot output pulse width is set to 0 (zero), the difference between input pulse width and output pulse width is less than $\pm 10 \mu\text{s}$.

When one-shot output pulse width is set to 0

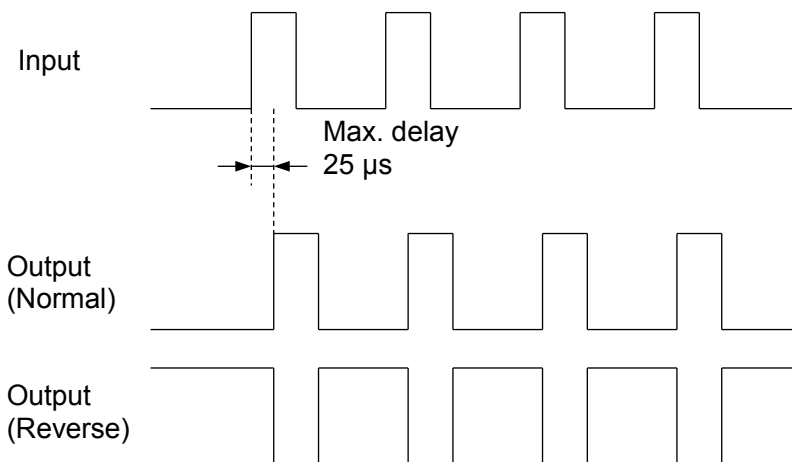

When one-shot output pulse width is set to any value except 0

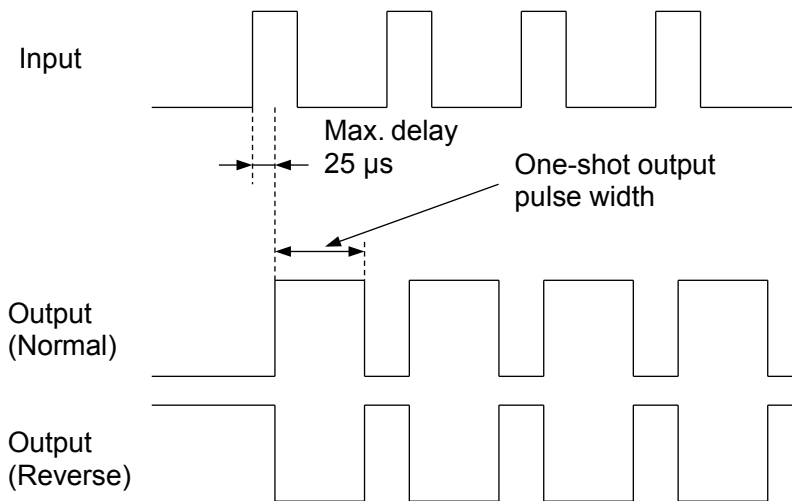

7.6 Detecting Unconnected Sensor

If pulses are not detected during the detection time-out below, the input will default to the initial status (0 Hz).

Multi-Display A or B will flash 0 (zero) when it indicates an input value.

Detection time-out:

Ultra-low frequency: 1000 seconds

Low frequency: 100 seconds

Frequency: 1 second

7.7 Indication Range

[Indication value for Input low limit] to

[Indication value for Input high limit + (Indication value for Input high limit – Indication value for Input low limit) x 10%]

However, for a value higher than 10000, the lower 4 digits will flash.

When exceeding the indication range, $\square\square\square\square$ will flash.

When pulse is absent, 0 (zero) will flash.

The placement of the decimal place follows the selection.

General Structure

Dimensions	22.5 x 89 x 70 mm (W x H x D)
Weight	1 output: Approx. 85 g (excluding socket) 2 outputs: Approx. 95 g (excluding socket)
Mounting	DIN rail
Case	Flame-resistant resin, Color: Black
Front panel	Polycarbonate

Installation Specifications

Power supply	100 to 240 V AC 50/60 Hz
Allowable voltage range	85 to 264 V AC
Power consumption	SGF: Approx. 8 VA SGFW: Approx. 9 VA SGFL: Approx. 9 VA
Ambient temperature	-10 to 55°C (Non-condensing, no icing)
Ambient humidity	35 to 85 %RH (Non-condensing)

Serial Communication (for SGFL)




Operation from an external computer	Reading and setting of various set values Reading of the input value and action status Function change
Communication line	EIA RS-485
Communication method	Half-duplex communication
Communication speed	9600, 19200, 38400 bps (Selectable by keypad) (Factory default: 38400 bps)
Synchronization method	Start-stop synchronization
Communication protocol	Modbus RTU
Start bit	1 bit
Data bit	8 bits
Parity	Even/Odd/No parity (Selectable by keypad) (Factory default: Odd)
Stop bit	1 bit or 2 bits (Selectable by keypad) (Factory default: 1 bit)
Response delay time	Response from the instrument can be delayed after receiving command from the host computer. 0 to 1000 ms (Factory default: 10 ms)

Standard Function


Power failure countermeasure	The setting data is backed up in the non-volatile IC memory.
Self-diagnosis	The CPU is monitored by a watchdog timer, and if an abnormal status occurs, the instrument is switched to warm-up status, turning all outputs OFF.

9. Troubleshooting

9.1 Indication

Problem	Possible Cause	Solution
 flashes when Multi-Display A or B indicates an input value.	Input signal source may be disconnected.	Check the input signal source.
Multi-Display A or B flashes  when Multi-Display A or B indicates an input value.	The sensor may be disconnected.	Replace with a new sensor.
	Check whether the sensor is securely mounted to the input terminals of this instrument.	Connect the sensor terminals to the instrument input terminals securely.
	If pulses are not detected during the detection time,  will flash. Signal source may be disconnected.	Check the input signal source.
4-digits are flashing.	For a value higher than 10000, the lower 4 digits will flash.	Check the input signal source.
Multi-Display A or B is irregular or unstable when it displays an input value.	There may be equipment that interferes with or makes noise near the instrument.	Keep the instrument clear of any potentially disruptive equipment.
Displays and indicators are unlit. If any key is pressed, they will light up.	The Indication Time (p.22) is set to any value other than 00 : 00. (Factory default is 30 : 00.)	To indicate continuously, set the Indication Time (p.22) to "00 : 00".

9.2 Key Operation

Problem	Possible Cause	Solution
If the DISP key is pressed, Multi-Display A indicates  , and the display mode cannot be switched.	The DISP key is in locked status.	Press the DISP key for approx. 3 seconds to release the key lock.

9.3 Operation

Problem	Possible Cause	Solution
When Multi-Display A or B indicates an input value, the input value does not change.	The sensor may be out of order.	Replace with the new sensor.
	Check whether input and output wires are securely connected to the I/O terminals of the instrument.	Ensure that input and output wires are securely connected to the I/O terminals of the instrument.
	Check whether the wiring of input and output are correct.	Wire them correctly.
No output	Selections in [Output 1 Normal/Reverse (p.20)] or [Output 2 Normal/Reverse (p.21)] may be incorrect.	Make a correct selection in [Output 1 Normal/Reverse (p.20)] or [Output 2 Normal/Reverse (p.21)].

10. Character Table

Please use the following factory default values for your reference.

Display mode

Setting Item	Multi-Display A	Multi-Display B	Data
Default Display mode	Follows currently indicated display mode.		
RUN display mode	Input value	Unlit	
Custom display mode 1	AAAA	AAAA	
Custom display mode 2	Input value	AAAA	
Unlit display mode	Unlit	Unlit	
All unlit display mode	Unlit	Unlit	
Model display mode	Model	Input, Output codes	

Setting mode

Setting Item	Multi-Display A	Multi-Display B	Data
Input setting mode	NNNN	Unlit	
Output 1 setting mode	OOOO	Unlit	
Output 2 setting mode *	OOOO	Unlit	
Instrument setting mode	NNNN	Unlit	
Communication setting mode	COMM	Unlit	
Custom display setting mode	OOSE	Unlit	

* Available only for the SGFW.

Input setting mode

Setting Item	Multi-Display A	Multi-Display B	Data
Frequency range group	HZSO	HZOO	
Frequency high limit	HZSO	9999	
Decimal point place	POON	POOO	
Indication value for Input low limit	SOOO	POOO	
Indication value for Input high limit	SOOO	9999	
Indication unit	NNNN	NNNN	
Save settings	SAVE	YES	

Output 1 setting mode

Setting Item	Multi-Display A	Multi-Display B	Data
Output 1 division	SOOO	POOO	
Output 1 one-shot output pulse width	SOOO	POOO	
Output 1 Normal/Reverse	SOOO	NNNN	
Save settings	SAVE	YES	

Output 2 setting mode

Setting Item	Multi-Display A	Multi-Display B	Data
Output 2 division	0000	0000	
Output 2 one-shot output pulse width	0000	0000	
Output 2 Normal/Reverse	0000	N000	
Save settings	SAVE	YES	

Instrument setting mode

Setting Item	Multi-Display A	Multi-Display B	Data
Indication time	0000	0000	
Auto/Manual	MARS	MAN0	
Manual mode auto return time	0000	0000	
Save settings	SAVE	YES	

Communication setting mode (SGFL)

Setting Item	Multi-Display A	Multi-Display B	Data
Instrument number	0000	0000	
Communication speed	0000	0000	
Data bit/Parity	0000	0000	
Stop bit	0000	0000	
Response delay time	0000	0000	
Save settings	SAVE	YES	

Custom display setting mode

Setting Item	Multi-Display A	Multi-Display B	Data
Multi-Display A	0000	0000	
Multi-Display B	0000	0000	
Save settings	SAVE	YES	

***** Inquiries *****

For any inquiries about this unit, please contact our agency or the vendor where you purchased the unit after checking the following.

[Example]

- Model ----- SGFW-F000-0-0
- Serial number ----- 154F05000

In addition to the above, please let us know the details of the malfunction, or discrepancy, and the operating conditions.

SHINKO TECHNOS CO., LTD.
OVERSEAS DIVISION

Head Office: 2-5-1, Senbahigashi, Minoo, Osaka, Japan

URL: <http://www.shinko-technos.co.jp/e/> Tel : +81-72-727-6100

E-mail: overseas@shinko-technos.co.jp Fax: +81-72-727-7006